




CONCRETE PATH TYPICAL SECTION - TYPE 1
SCALE 1:20 (A1)

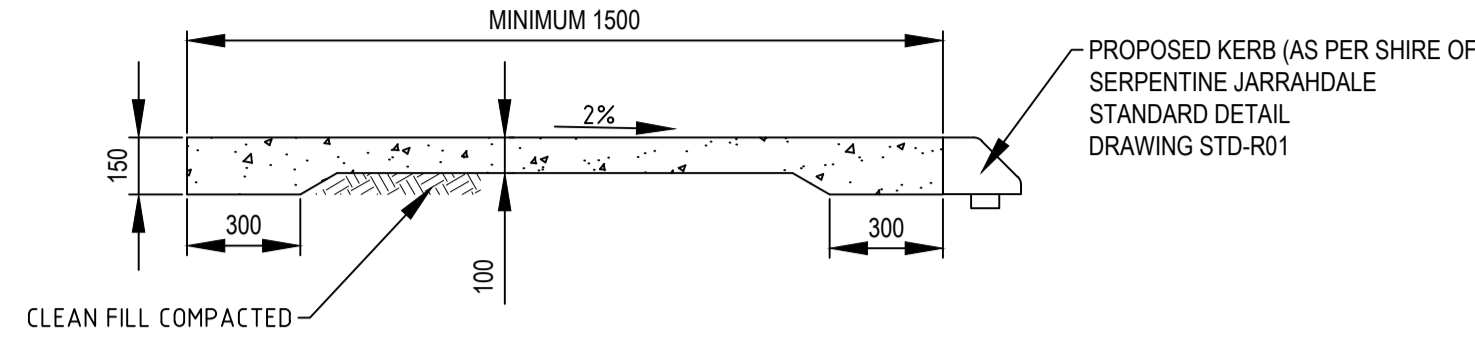


CONCRETE PATH TYPICAL SECTION - TYPE 2
SCALE 1:20 (A1)

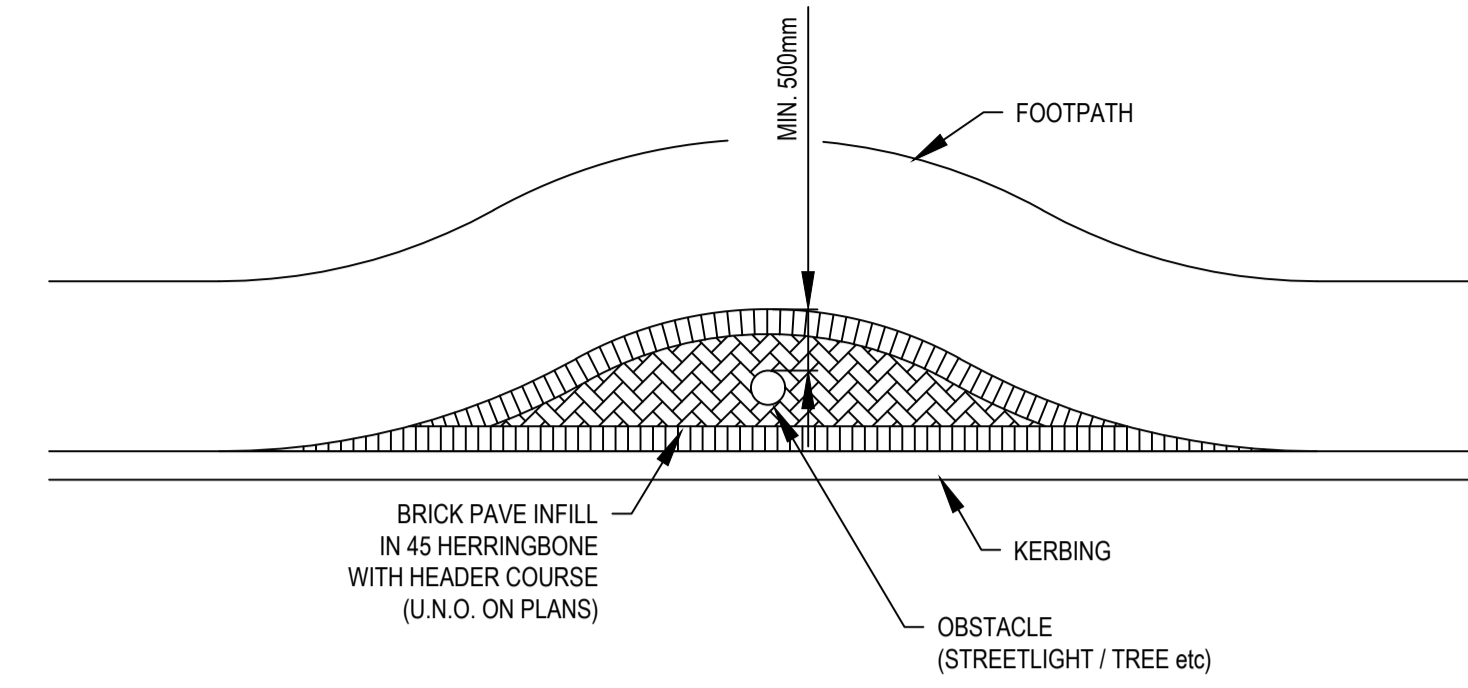


INFILL AT PATH DIVERSION
N.T.S

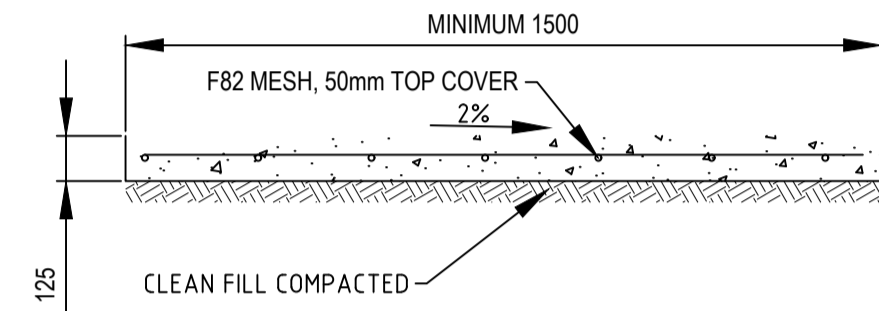


CONCRETE PATH TYPICAL SECTION - TYPE 3
SCALE 1:20 (A1)

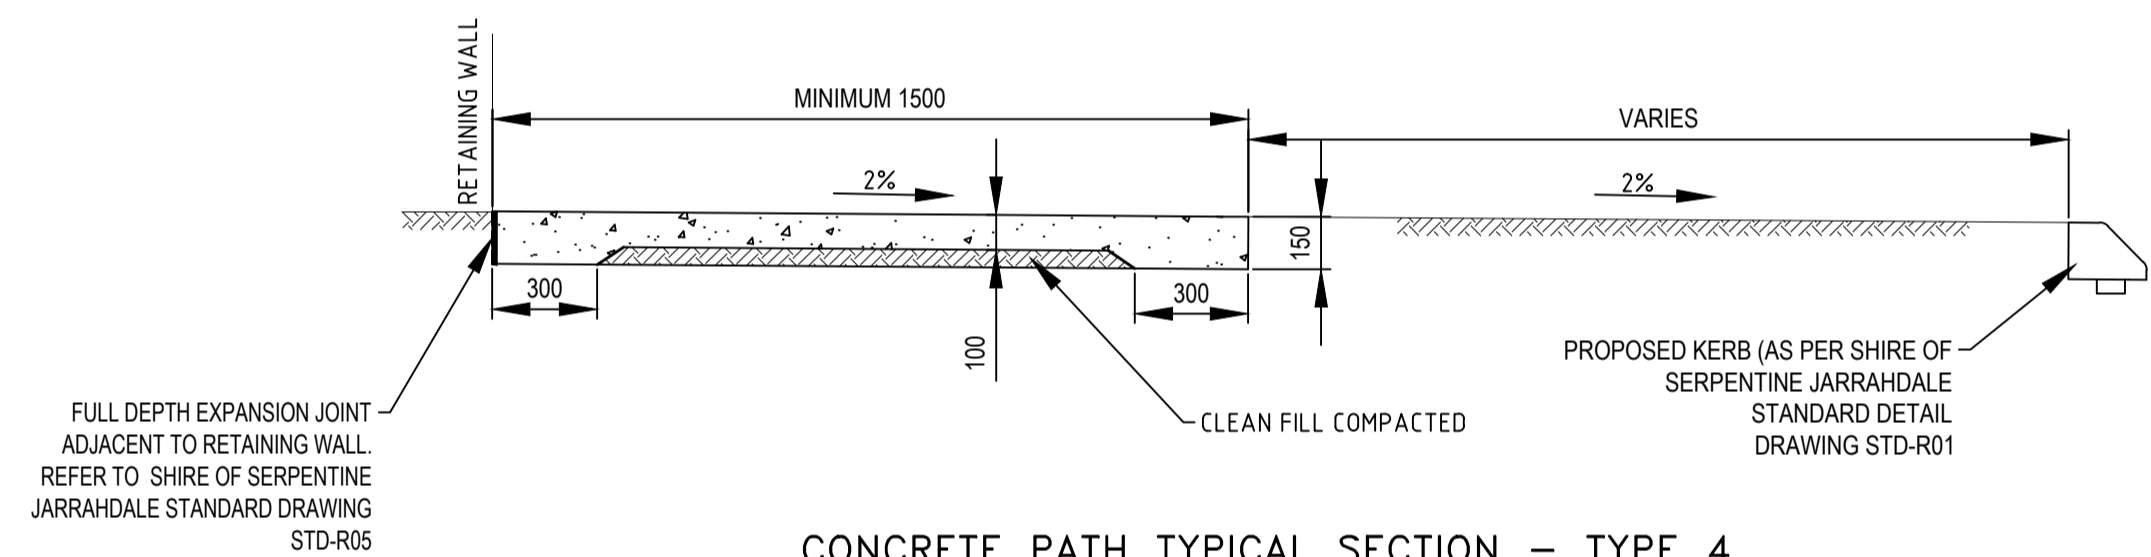

CONCRETE PATH TYPICAL SECTION - TYPE 4
SCALE 1:20 (A1)

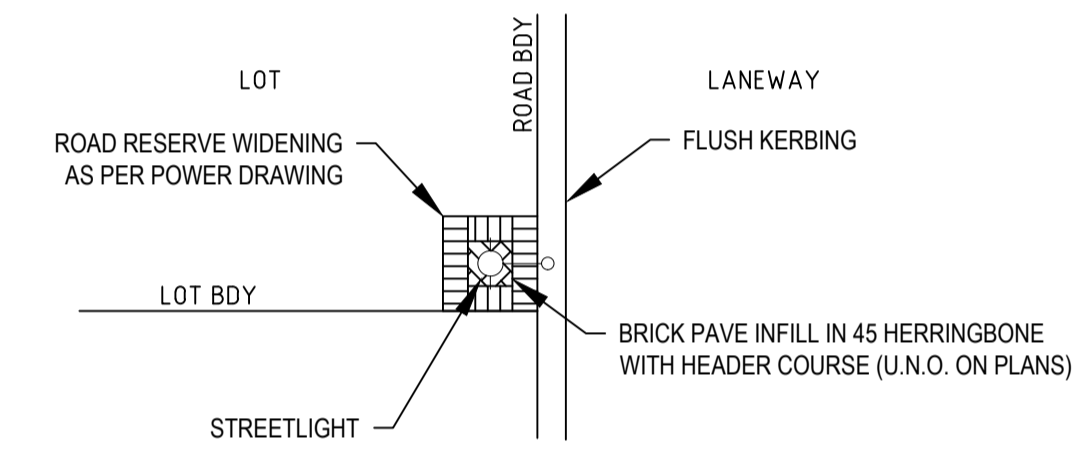

INFILL AT LANEWAY STREETLIGHTS
N.T.S

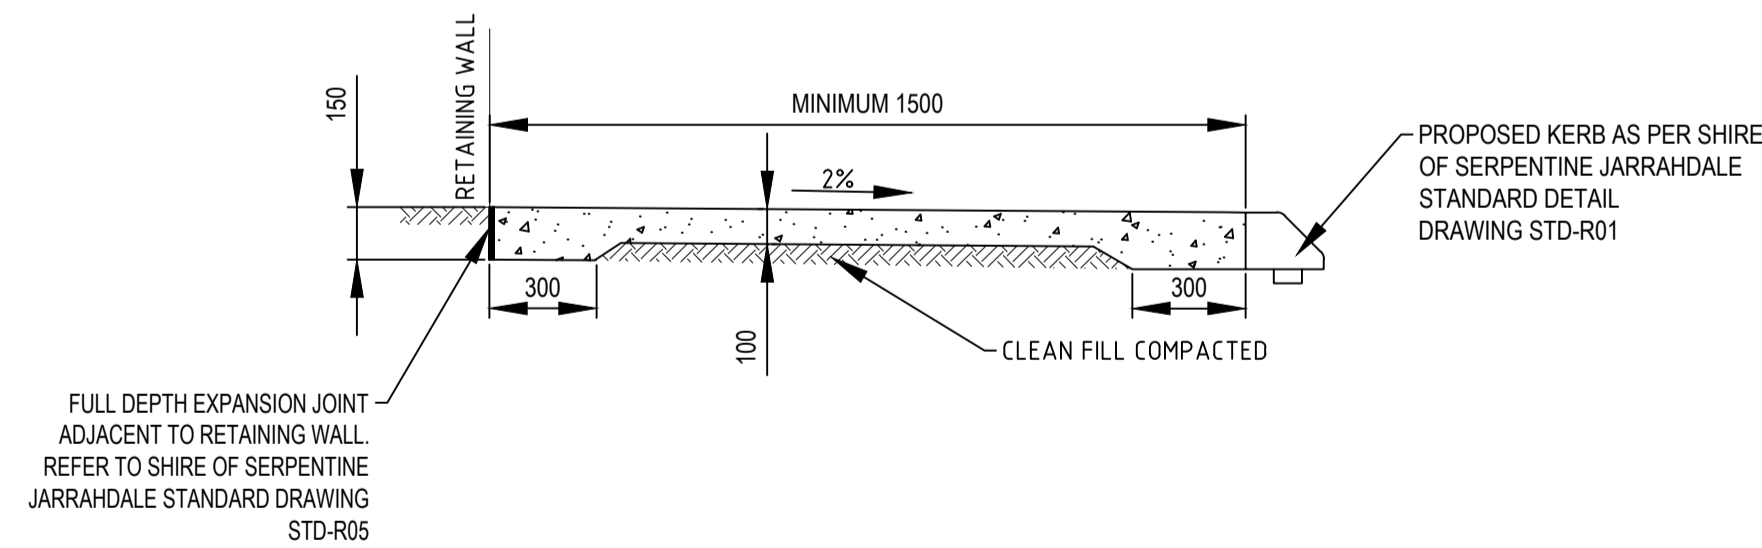

CONCRETE PATH TYPICAL SECTION - TYPE 5
SCALE 1:20 (A1)

NOTES:

- FOUNDATION TO BE COMPACTED TO 95% MODIFIED DRY DENSITY.
- ALL CONCRETE FOR FOOTPATH CONSTRUCTION TO BE A MINIMUM OF 25MPa, MAXIMUM 20mm AGGREGATE AND A MAXIMUM SLUMP OF 80mm-100mm.
- REINFORCED CONCRETE PATH SHALL BE MINIMUM OF 125mm THICK, 32MPa @ 28 DAYS COMPRESSIVE STRENGTH WITH F82 REINFORCEMENT MESH
- BEDDING - SAND (100mm MINIMUM).
- EXPANSION JOINTS AS PER SHIRE OF SERPENTINE JARRAHDALE STANDARD DRAWING STD-R05.
- CONTRACTION JOINTS AS PER SHIRE OF SERPENTINE JARRAHDALE STANDARD DRAWING STD-R05.
- SURFACE TO BE BROOM FINISH, NON-SLIP PARALLEL TO KERB LINE, WITH SMOOTH TROWELLED EDGE APPROXIMATELY 75mm WIDE AT EDGES.
- DIMENSIONS IN MILLIMETRES.
- LONGITUDINAL GRADE SHOULD NOT EXCEED 1 IN 20.
- WHERE LONGITUDINAL GRADE IS GREATER THAN 1 IN 14, LANDINGS WILL BE PROVIDED EVERY 6m.
- VERTICAL CLEARANCES ALONG PATHS SHOULD BE A MINIMUM OF 2.4m.
- WHERE STREET FURNITURE (POLES, BENCHES, RUBBISH BINS, POSTS, ETC) ARE LOCATED IN PATH, A MINIMUM UNOBSTRUCTED WIDTH OF 1.2m MUST BE MAINTAINED, PLUS CLEARANCE TO OBSTACLE.
- WHERE COVERS (NBN, TELSTRA, WATER, DRAINAGE, ETC) ARE LOCATED WITHIN PATHS, A MINIMUM CONCRETE EDGE THICKNESS OF 200mm MUST BE PROVIDED AROUND THE COVER, AND EXPANSION JOINTS ARE REQUIRED SURROUNDING THE COVER.

C:\Engineering\Standard Details\DWG\STD-R07 - FOOTPATH DETAILS.dwg

Amendments		Scale	Date		By		Approved	
		AS SHOWN						
		N/A						
B	05/02/26	OFFSET FROM BOUNDARY REMOVED, CLEARANCE TO OBSTACLE UPDATED, NOTE 2 REVISED	BC	VB				
A	30/11/23	ISSUED FOR REVIEW	BV	NS				
No	Date	Revision	By	Approved				

Infrastructure and Design

Drawn: BC	Date: 05/02/26	Signat:
Designat: BV	Date: 05/02/26	Signat:
Checked: VB	Date: 05/02/26	Signat:
Manager Engineering Services:		

SHIRE OF SERPENTINE JARRAHDALE
STANDARD DRAWINGS

ROAD - FOOTPATH DETAILS

Sheet No:	1 OF 1
Revision No:	B
DWG No:	STD-R07